


# Instructions

## Eagle Quantum Premier®

### Hazardous Location Electronic Based Fire and Gas Alarm Control Panel and Automatic Releasing for Pre-Action and Deluge Systems EQ3900E Series

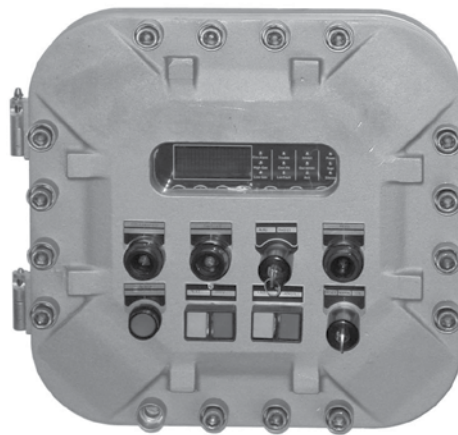

# Table Of Contents

- DESCRIPTION ..... 1
- FEATURES ..... 1
- ENCLOSURE ..... 1
- SPECIFICATIONS ..... 2
- INSTALLATION ..... 2
  - Mounting ..... 2
  - Enclosure Entry ..... 2
  - Wiring Instructions ..... 2
- ORDERING INFORMATION ..... 2
- DESIGN CRITERIA ..... 3
- APPENDIX A - FM AND CSA APPROVALS ..... 6
- EQUIPMENT SAFETY SYMBOLS ..... 7

## Eagle Quantum Premier® Hazardous Location Electronic Based Fire and Gas Alarm Control Panel and Automatic Releasing for Pre-Action and Deluge Systems EQ3900E



Explosionproof / Flameproof

### DESCRIPTION

As part of providing a total systems solution to industrial clients around the world, Detector Electronics Corporation offers several certified systems enclosures for mounting in hazardous locations.

These enclosures can be configured to house various combinations of Eagle Quantum Premier controllers and 8 channel IO modules, along with a power distribution module. They are intended for use in hazardous locations, with certifications that include Class 1, Division 1 and Class 2, Division 1 per the National Electrical Code.

Regulations require that enclosures and their contents be certified as an entity for use in a hazardous location.

### FEATURES

- Hazardous area certified solution (Explosionproof Class I, Zone 1)
- Simple wire installation into terminal blocks
- Configurable device selection for the enclosure
- Electronics and wiring tested at the factory

### ENCLOSURE

Depending upon the equipment selection, the front door may or may not have a window, indicators, and operators installed.

## SPECIFICATIONS

### INPUT VOLTAGE—

24 Vdc nominal, 18 to 30 Vdc. 10% overvoltage will not cause damage to equipment.

### TEMPERATURE RANGE—

Operating: -4°F to +140°F (-20°C to +60°C)  
Storage: -40°F to +140°F (-40°C to +60°C)

### HUMIDITY—

5% to 95%, non-condensing.

### CERTIFICATION—

FM/CSA: See Appendix A for FM and CSA details.



Refer to the Eagle Quantum Premier manual (form number 95-8533) for system certification details, individual controller and module specifications, and installed equipment operation details.

### WEIGHT (Approximate, wo Electronic Assemblies)—

12x12x8:	83 pounds (38 kg)
12x24x12:	225 pounds (102 kg)

## INSTALLATION

The enclosure must be securely bolted in place.

### MOUNTING

Refer to the appropriate drawing for mounting dimensions.

### ENCLOSURE ENTRY

The number and position of wiring entries must be specified when the enclosure is ordered. The enclosures can accept a certain number and size of entries as specified by enclosure manufacture. Only manufacturer recommended cable glands can be used with the enclosures. Consult with Det-Tronics Corporation on the exact number and sizes of entries that are available for each enclosure.

### WIRING INSTRUCTIONS

Electrical wiring schematics for the custom device configuration will be provided with the enclosure. Wiring is made to the appropriate terminals located inside of the enclosure and is secured in place.

## ORDERING INFORMATION

Refer to the EQ3900E Enclosure Model Matrices for details.

For assistance in ordering a system to fit your application, please contact:

Detector Electronics Corporation  
6901 West 110th Street  
Minneapolis, Minnesota 55438 USA  
Operator: (952) 941-5665 or (800) 765-FIRE  
Customer Service: (952) 946-6491  
Fax: (952) 829-8750  
E-mail: [det-tronics@det-tronics.com](mailto:det-tronics@det-tronics.com)

or contact your local sales office, which can be found on the Det-Tronics web site:

**[www.det-tronics.com](http://www.det-tronics.com)**

## EQP3900E Enclosure Model Matrix

MODEL	DESCRIPTION	
EQ3900E	EQP, Class 1, Division 1/Zone 1 Enclosure Solution	
	TYPE	CONFIGURATION
	XXXXXXXX-XXX	Sales Order # Drawing Packet

## EQP3900E Design Criteria

EQ3900E EQP System Enclosure Solutions										
Size	Window	Operator(s)	Controller EQ3xxx	I/O Modules (EQ7xx)	EQ3800PDM	EQ3LTM	EQ2220GFM	EQ2230RSP	Terminal Strip	Fuse(s)
12x12x08	Optional	≤8	≤1	≤1	≤1	≤1	≤1	≤1	≤1	Yes
12x24x12			≤1	≤4	≤1	≤1	≤1	≤1	≤1	Yes

### Notes:


EQ3xxx = EQ3001, EQ3005, EQ3015, EQ3150.

EQ37xx = EQ3700DCIO, EQ3710AIM, EQ3720RM, EQ3730EDIO, EQ3750ASH, EQ3760ASM, EQ3780HSDM.


Operator(s) = Lamps (Amber, Red, Green, White), Push-Buttons, Double Push-Buttons, Key Switch (2 & 3 Position).

Note: No ingress rating with operators installed.

Note: Terminals and fuses must be NRTL listed. Installation must follow OEM requirements.

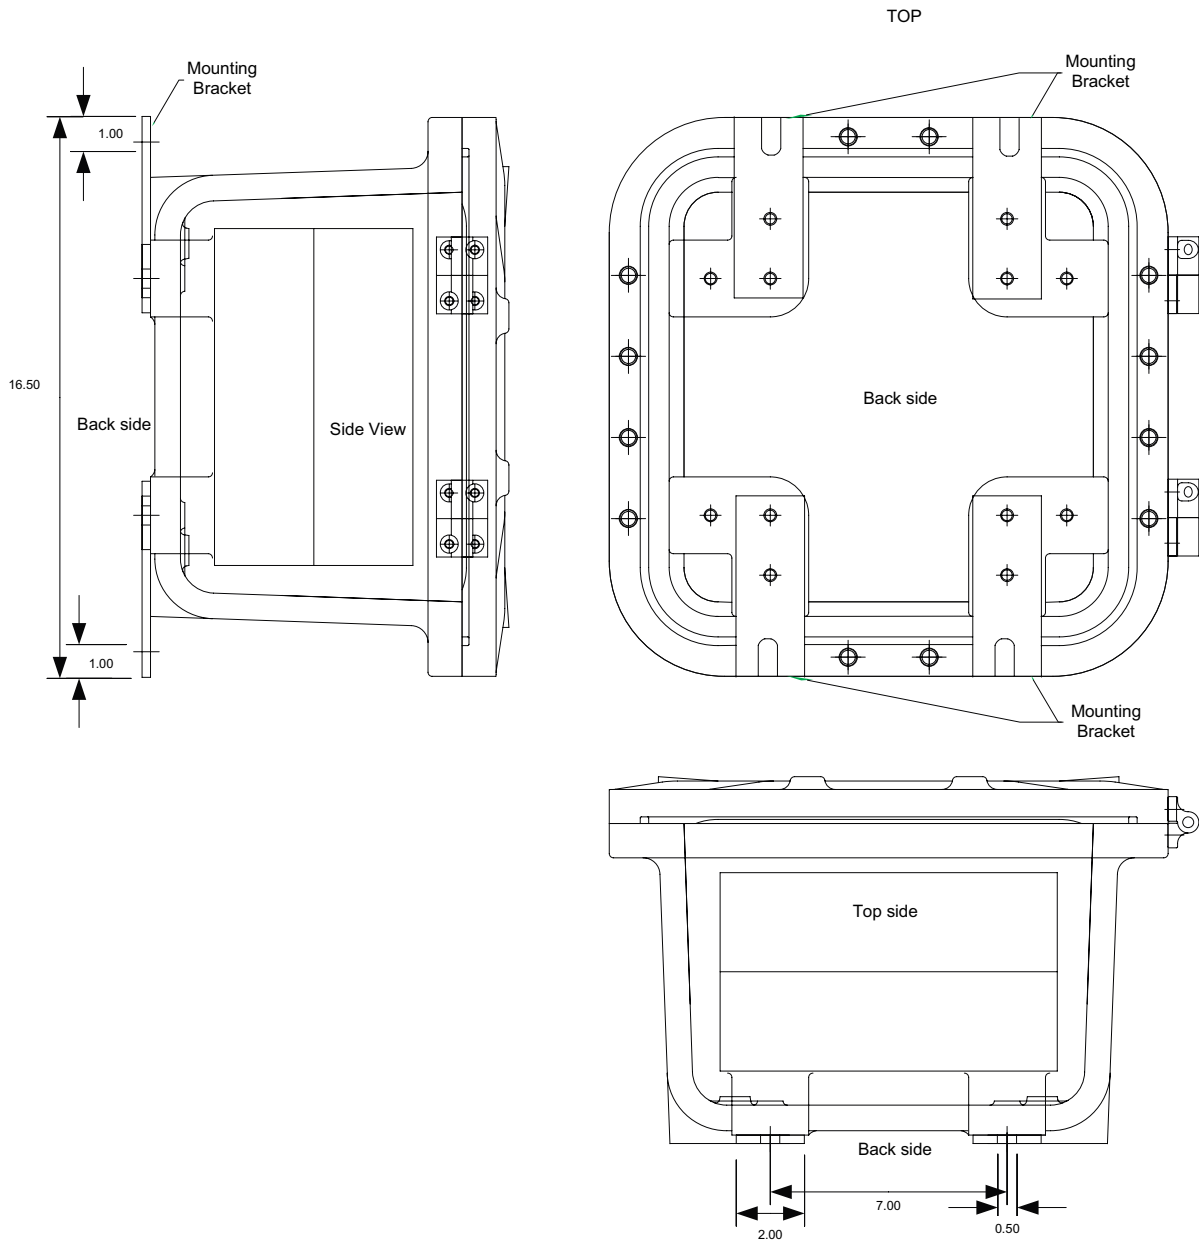

**Explosionproof / Flameproof EXB-12128**  
**Enclosure Mounting Bracket Location**  
**(12" x 12" x 8")**

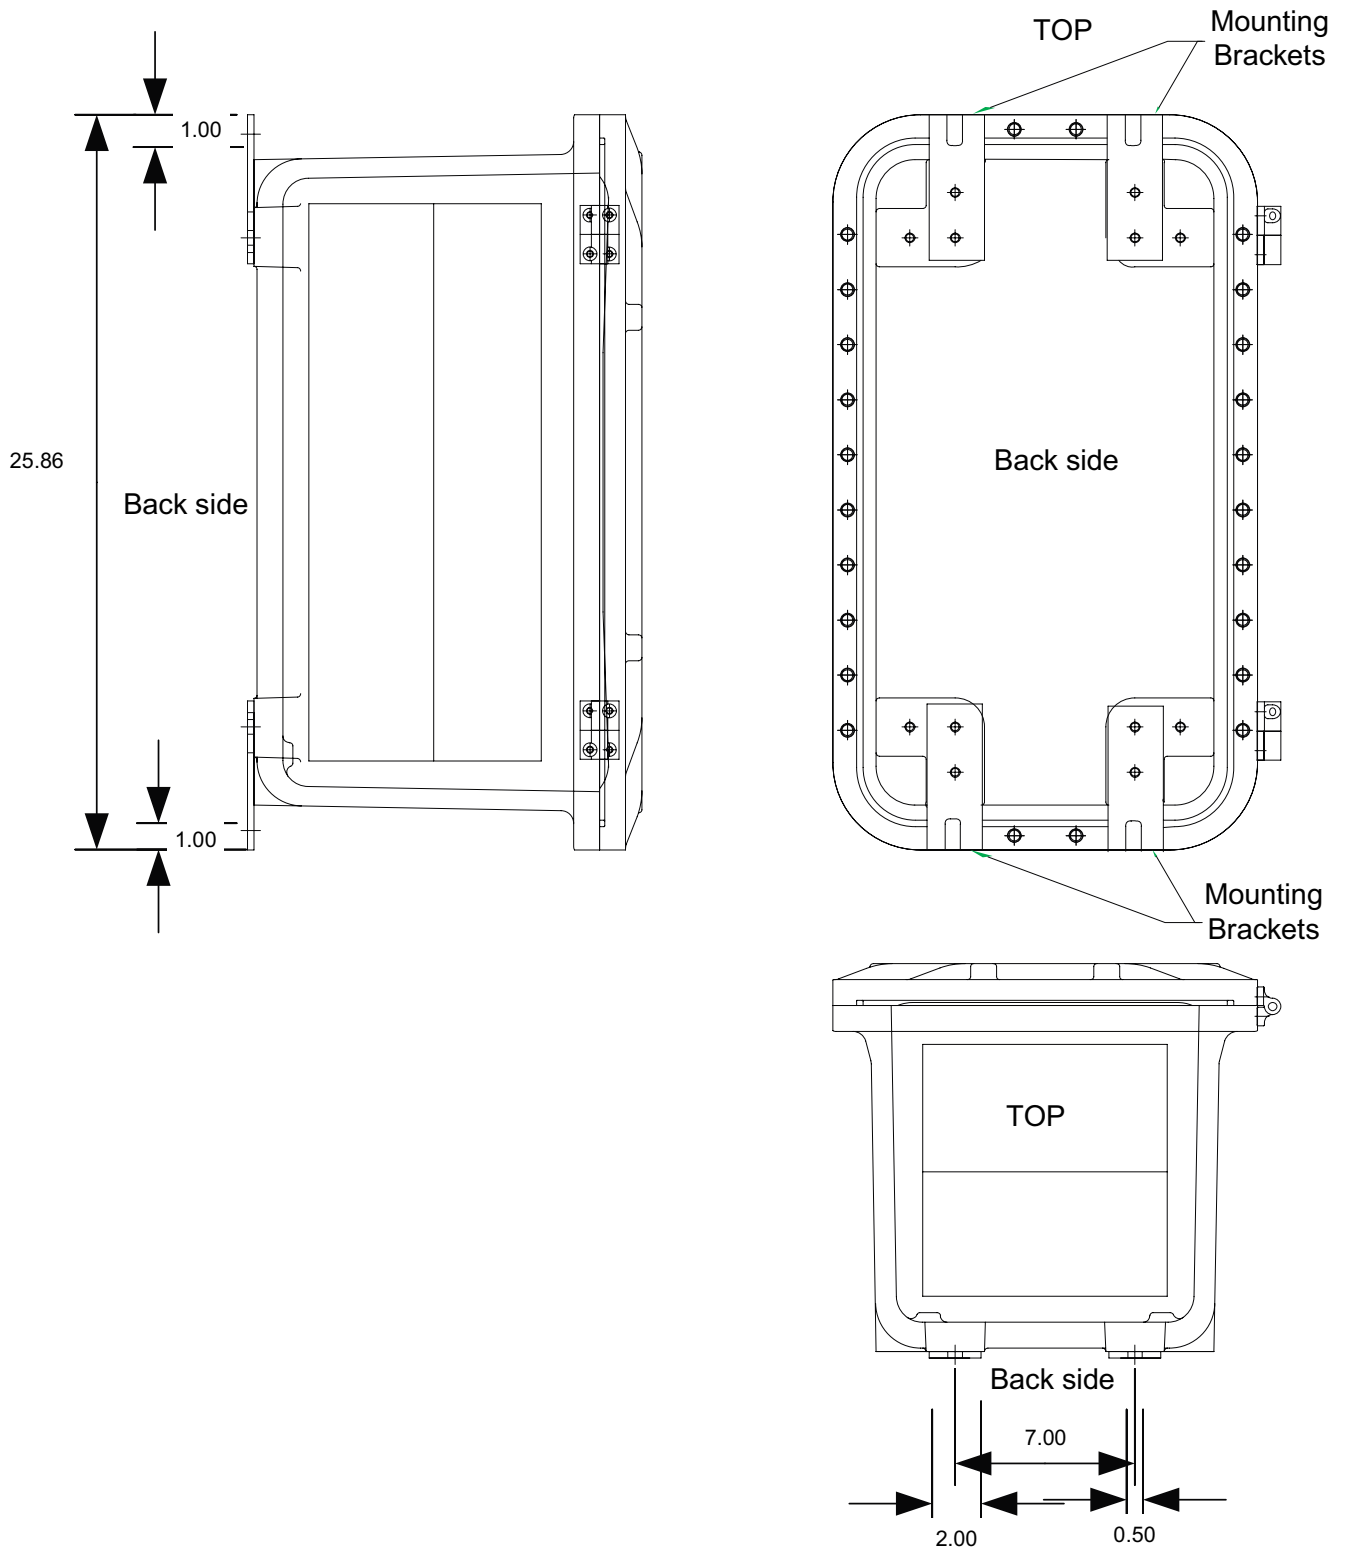

**Explosionproof / Flameproof EXB-122412  
Enclosure Mounting Bracket Location  
(24" x 12" x 12")**

# **APPENDIX A**

## **FM and CSA APPROVALS**

### **When Key Switch is Installed**

Class I, Div. 1, Groups C & D.

Class II, Div. 1, Groups E, F, & G.

Ambient temperature limits -4°F to +140°F (-20°C to +60°C)

Conduit seal required within 18" of enclosure

### **When Operators Except Key Switch are Installed**

Class I, Div. 1, Groups B, C & D.

Class II, Div. 1, Groups E, F, & G.

Ambient temperature limits -4°F to +140°F (-20°C to +60°C)

Conduit seal required within 18" of enclosure

### **When No Operators are Installed**

Class I, Div. 1, Groups B, C & D (T5).

Class II, III Div. 1, Groups E, F, & G (T5).

Class I, Zone 1, Group IIB (T5).

















Type 4

Ambient temperature limits -4°F to +140°F (-20°C to +60°C)

Conduit seal required within 18" of enclosure



## EQUIPMENT SAFETY SYMBOLS

Symbol	Description
	Direct current
	Alternating current
	Both direct and alternating current
	Three-phase alternating current
	Earth (ground) current
	Protective conductor terminal
	Frame or chassis terminal
	On (power)
	Off (power)
	Equipment protected throughout by double insulation or reinforced insulation
	Caution, possibility of electric shock
	Caution, hot surface
	Caution*
	In position of bi-stable push control
	Out position of bi-stable push control
	Ionizing radiation

\* Manufacturer to state that documentation must be consulted in all cases where this symbol is marked.



95-8763



FlexSonic® Acoustic  
Leak Detector



X3301 Multispectrum  
IR Flame Detector



PointWatch Eclipse® IR  
Combustible Gas Detector



FlexVu® Universal Display  
with GT3000 Toxic Gas Detector



Eagle Quantum Premier®  
Safety System

---

**Corporate Office**  
6901 West 110<sup>th</sup> Street  
Minneapolis, MN 55438 USA  
[www.det-tronics.com](http://www.det-tronics.com)

Phone: 952.946.6491  
Toll-free: 800.765.3473  
Fax: 952.829.8750  
[det-tronics@det-tronics.com](mailto:det-tronics@det-tronics.com)

All trademarks are the property of their respective owners.  
© 2019 Detector Electronics Corporation. All rights reserved.

Det-Tronics manufacturing system is certified to ISO 9001—  
the world's most recognized quality management standard.

